

**INSPECTION TAG REQUIREMENTS for Gas Meter sets revised 12/18/2017**

**MOBILE HOMES-INSIDE AND OUTSIDE CITY LIMITS:** Must have green mobile home inspection or permit. The contractor must fax 765- 5670 or bring permit to 5200 Oakland Ave. The completed permit must be turned in after the tag on the yard line is issued. Note on the permit if there is a stand leg.

**If you have any questions please call MHD at 222-9870.**

**BERNALILLO COUNTY - GOOD FOR 30 DAYS**

**Orange-** Final, OK to set. Elevated pressure sets will be noted

**Turquoise (Blue) -**temporary heat/gas-ok to set, good from Oct. 1-Apr. 30

**Yellow card stock -**Correction Notice, do not set.

**White tag –** Ok to Bury ONLY yard line - do not set

**If you have questions call Dawn Raia, Senior Plumbing/Mechanical Inspector 991-0370**

**CITY OF ALBUQUERQUE - TAGS: GOOD FOR 60 DAYS**

**Orange-**Final, OK to set. Elevated pressure sets will be noted. High-pressure test OK or 24-hour recorder OK.

**Turquoise (Blue)-**Temporary gas, OK to set.

Temporary gas (for temp heat) good only from October 1-April 30

**White-**Correction Notice, do not set.

**If you have questions call Roger Coble, Chief Plumbing/Mechanical Inspector 924-3365**

**RIO RANCHO - INDEFINATE AS LONG AS READABLE and NO CHANGE IN OCCUPANCY**

**YELLOW-** Final, OK to set.

**BLUE-** Final, High pressure, OK to set.

**RED-**Unsafe, do not set.

Rio Rancho tags are issued in Town of Bernalillo and Placitas (west of Juniper road)

**If you have questions call Wayne York Plumbing/Mechanical Inspector 803-3384**

**STATE of NM- CID TAGS - GOOD FOR 30 DAYS**

**LIME GREEN (yellow)-** Final, OK to set. Elevated pressure sets will be noted medium or high-pressure test ok.

issue Temporary Heat tags.

**BLUE-** Yard line only- No final inspection; do not set.

State tags are issued in Placitas, (east of Juniper road) Algodones, and any other area not covered by the City of Albuquerque, Bernalillo County or Rio Rancho.

**PUEBLOS:**

**NO INSPECTION REQUIRED. HOWEVER, A WRITTEN STATEMENT STATING A PRESSURE TEST WAS PREFORMED IS REQUIRED.**

**FEDERAL PROPERTY:**

No inspection required.

**PER LOCAL POLICY:**



Per local policy, Gas Co. technicians don't light any appliance on a new set or reset anytime the premise has been inspected. This is the plumber's responsibility. However, the techs may use their own discretion if they feel a light up is necessary.

In some cases where a meter was removed for idle, no inspection is needed regardless of how long the meter has been out of the loop unless the Tech feels it is necessary. An inspection is needed only if new appliances have been installed or alterations to the piping have been made.



# Gas Meter Location Criteria

## Meter Locations

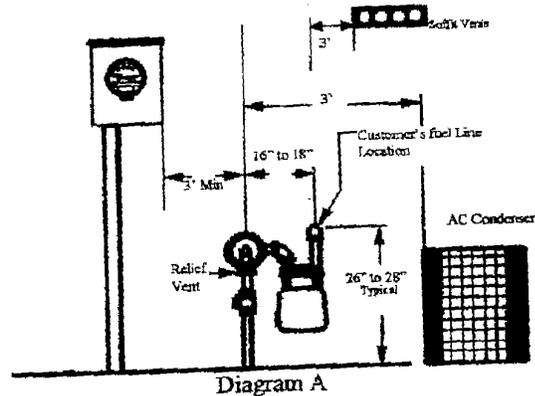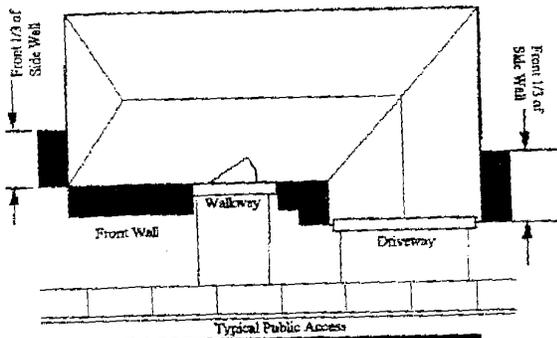

## Gas Meter Clearances

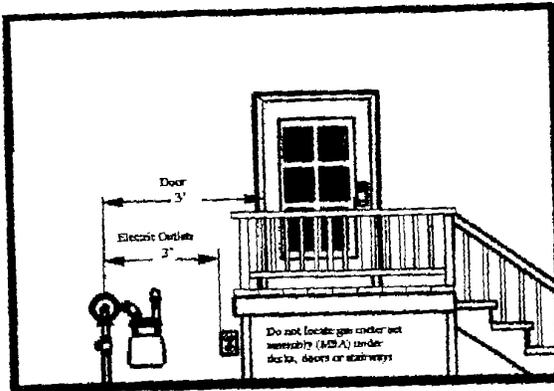


Diagram B

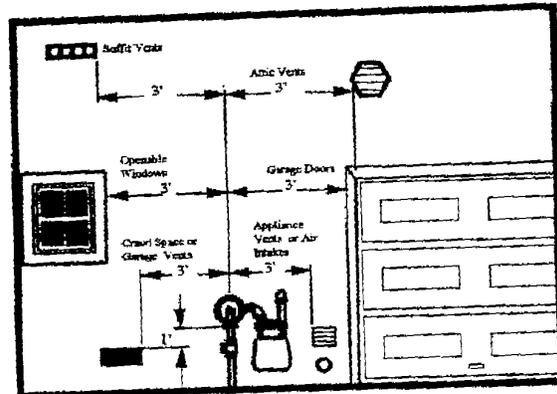


Diagram C

## Gas meter minimum clearance requirements from the relief vent

Building Feature	Horizontal	Under	Above	Diagram	Notes
Appliance Combustion Air Intake	3 feet *	Not Permitted		C	**3 feet minimum or greater as specified by the appliance manufacturer
Appliance Vents	3 feet	Not Permitted		A, C	
Attic Vents	3 feet	Not Permitted		C	*** may be closer if separated by a wall, contact PNM for specifications
Crawl Space Vents / Garage Vents	3 feet	Not Permitted		B,C	
Doors / Garage Doors	3 feet	Not Permitted		A	
Electric Meters	3 feet	Not Permitted			
Roof Canale (Drain)	12"	Not Permitted			
Electric Outlet	3 feet	Not Permitted			
Return Air Intake/ Swamp Cooler	10 feet **	Not Permitted		A,C	
Soffit Vents (single story)	3 feet	Not Permitted		C	
Operable Windows (includes 2 <sup>nd</sup> story)	3 feet	Not Permitted		A	
AC Condenser	3 feet	Not Permitted			
Any Ignition Source	3 feet	Not Permitted	Not Permitted		