


Installation of Attic Furnace

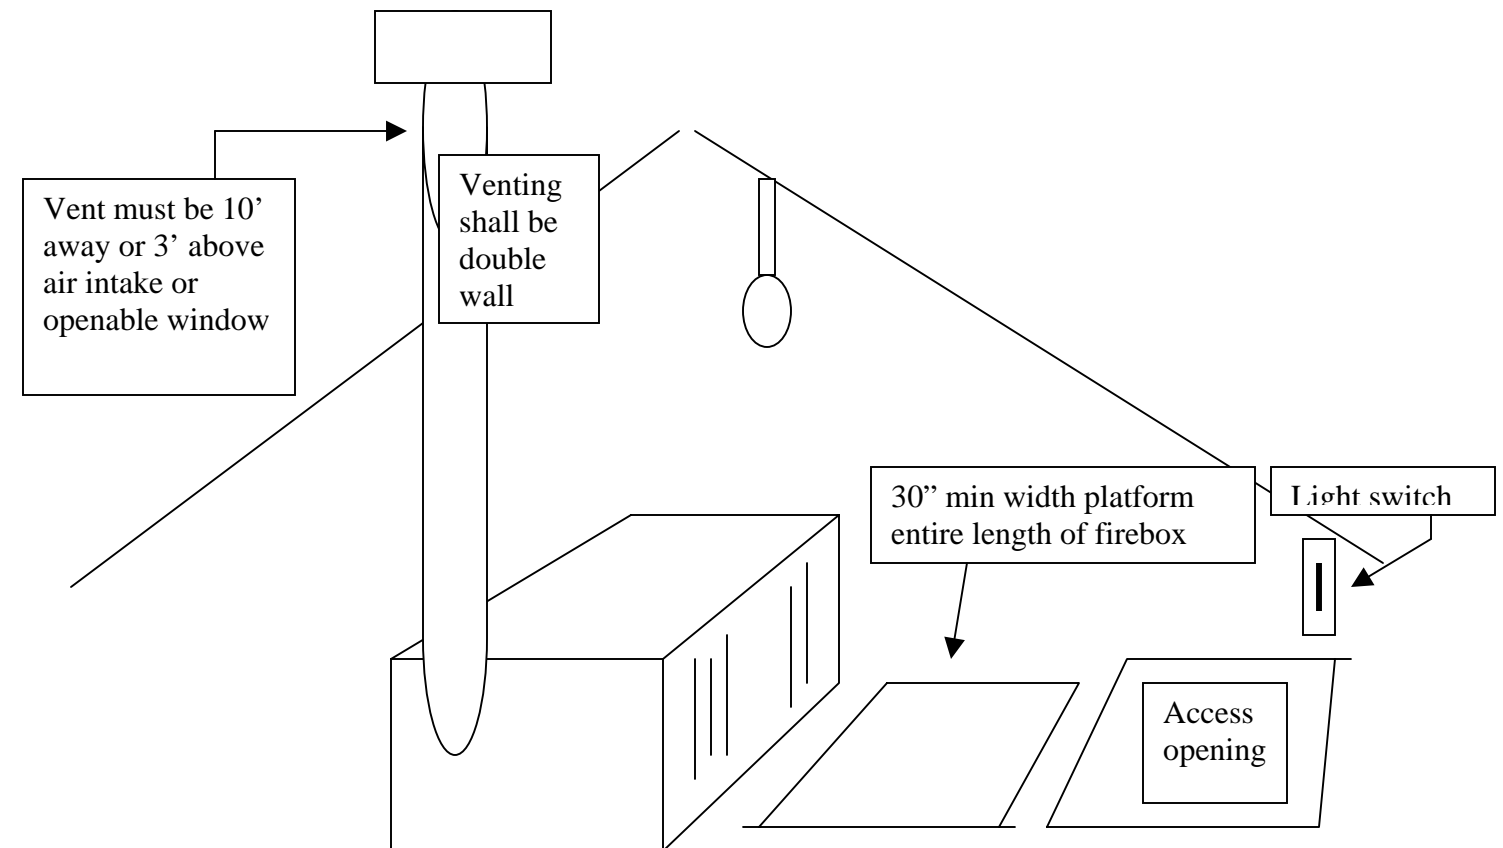

Must provide combustion air.

- Soffit Vents are not acceptable.

Catwalk shall be provided. Maximum 20' in length, 30" wide.

Horizontal or Vertical installation shall require double wall vent piping from appliance through roof.

No Single wall vent shall be allowed.

Access must be large enough to remove furnace.